


STANDARD VALVE APPR
BY DEPT WITH STD VALVE
BOX, FRAME AND COVER

MXU BATTERY PACK MUST BE MOUNTED
ON SIDEWALL OF METER BOX

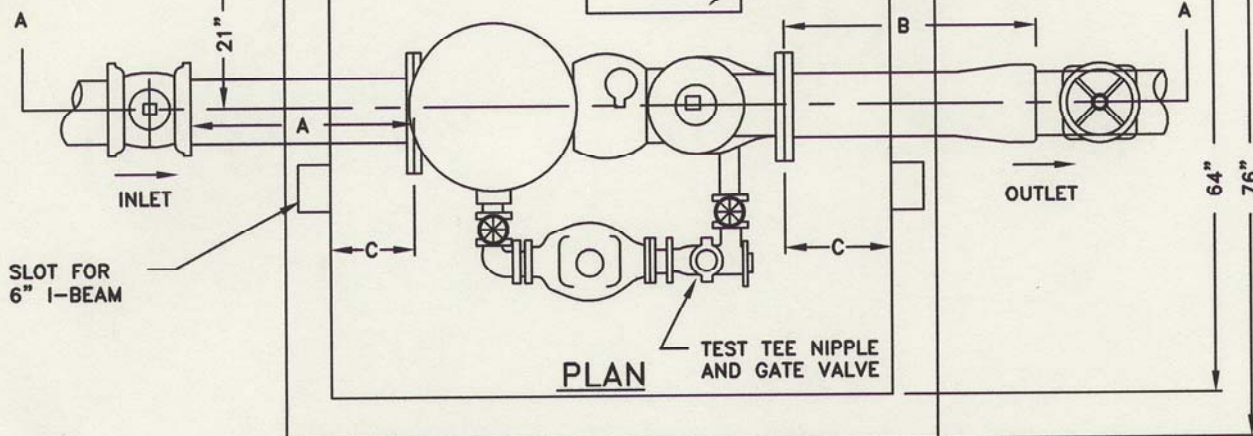


10- V-8435 OR
JBS 8121 FRAME
AND COVER


METER	A	B	C	D	WIDTH
6"	24"	18"	6"	45"	30 1/2"
8"	28"	22"	10"	55"	33 1/2"

SEE DWG. WDET-002F
FOR DETAIL OF COVER

GROUT
AROUND
FRAMES

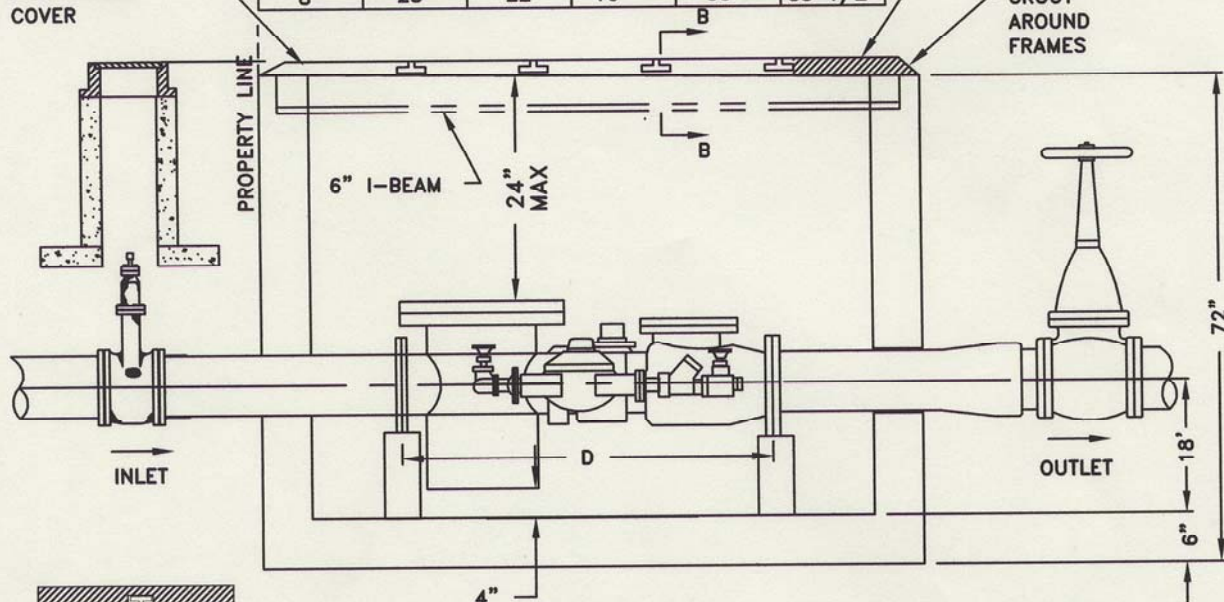

B-B



INSTALL DOUBLE SMALL
VALVE BOX FRAMES AND
COVERS FOR VALVE WITH
HANDWHEEL.
WHEEL VALVE AS SPECIFIED
BY AMERICAN INSURANCE
ASSOCIATION.

CONCRETE : 4500 PSI @ 28 DAYS
REINFORCED W/ #4 @ 12" C/C E.W.

RADIO READ UNIT (MXU) TO BE INSTALLED
ON SERVICE LINES AS INDICATED BY
METRO WATER SERVICES PERMIT OFFICE.
REFERENCE DETAIL WDET002A-1 FOR
LARGE METER BOX RADIO READ UNIT
(MXU) CONDUIT AND MOUNTING LOCATIONS.

MXU TO BE INSTALLED AS PER
MANUFACTURERS SPECIFICATIONS.

METRO WATER SERVICES

SCHLUMBERGER
6" AND 8" FIRE METER INSTALLATION
WITH NEPTUNE 1-1/2" (6") OR 2" (8") DISC BY-PASS

NOT TO SCALE DATE: 2/25/05

DWG. NO. WDET018H

METRO
WATER SERVICES

Hal Battrop
LICENSED DISTRIBUTION OPERATOR

SP
DIRECTOR OF WATER AND SEWERAGE SERVICES